DATA SHEET - SPLENDIDE Washer and Dryer (120V)

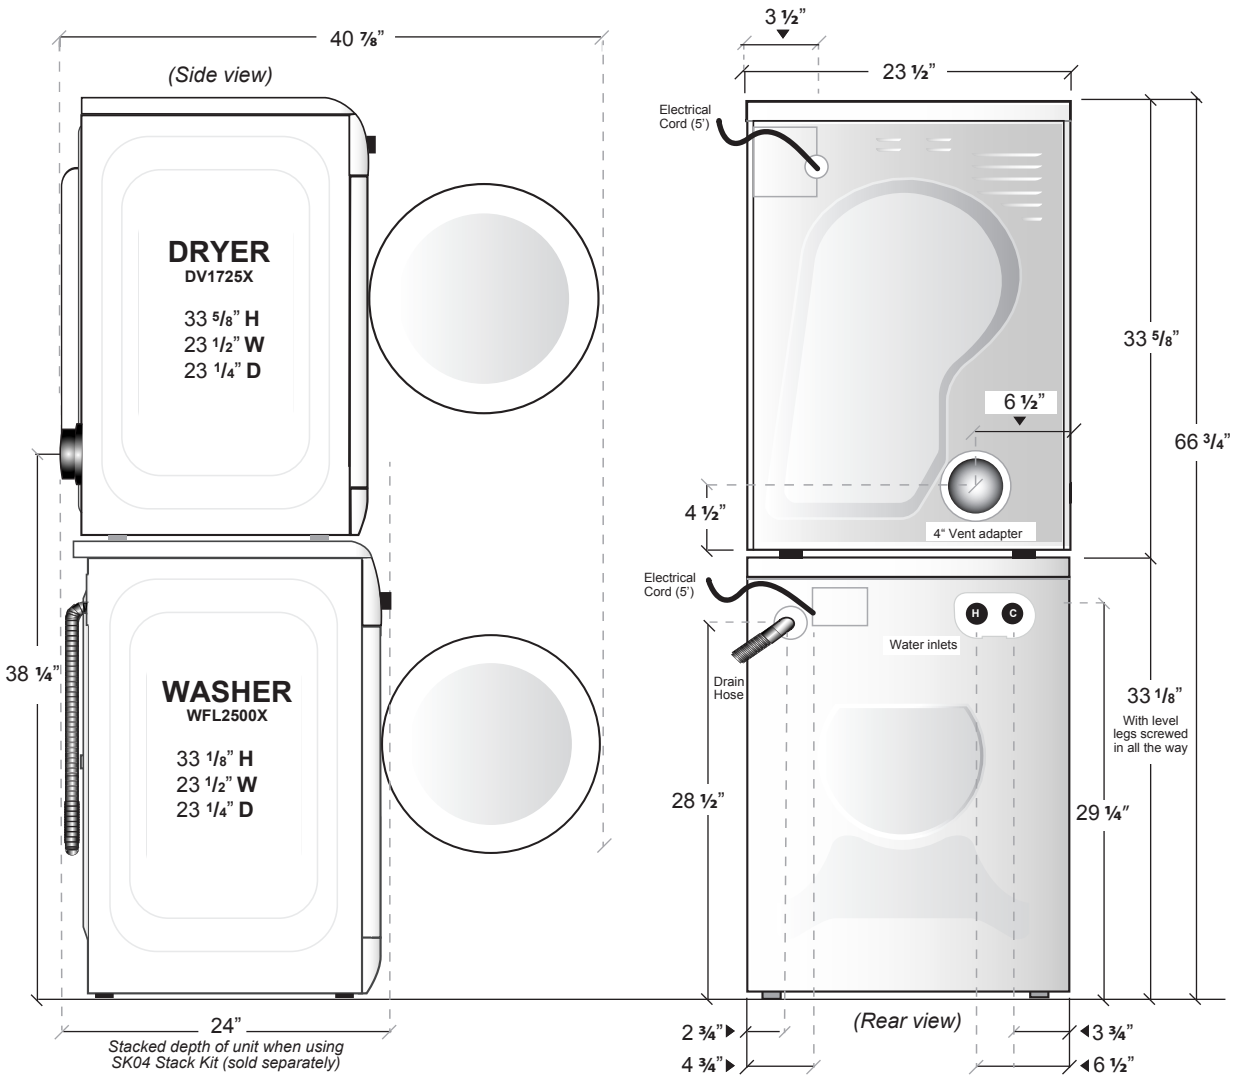

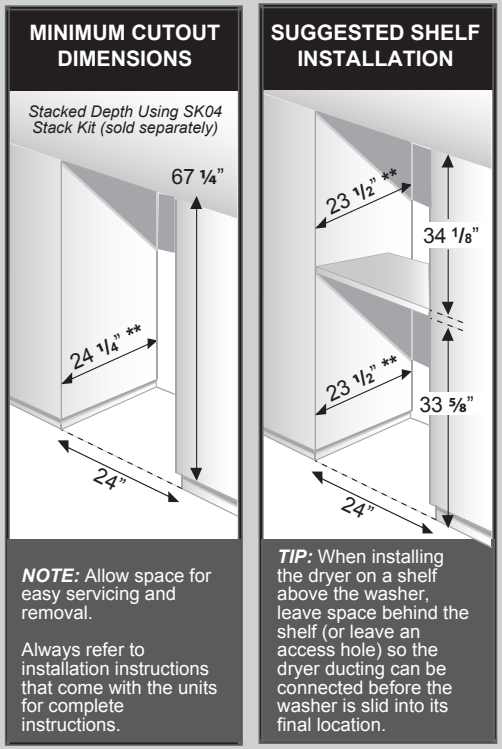

NOTE: Allow space for easy servicing and removal.

Always refer to installation instructions that come with the units for complete instructions.

TIP: When installing the dryer on a shelf above the washer, leave space behind the shelf (or leave an access hole) so the dryer ducting can be connected before the washer is slid into its final location.

** Min. dimension shown. Dimension may increase depending on standpipe location.

Included With WFL2500X Washer



2 Water inlet hoses | Electrical conn. | Flexible drain hose (5' length) | Drain hose u-clamp

Optional Accessories (Sold Separately)

- ***PI22*** Drain-A-Way Pan
- ***1003*** All-Natural HE Laundry Powder
- ***VID403A/AB/AC*** Vent Kit
- ***MK01*** SecureFit Brackets
- ***SK04*** RV/Marine Stack Kit
- ***VI490D*** 90° Dryer Vent Elbow



120V

Product model numbers

WFL2500X Front-loading Washer | **DV1725X 120V Dryer**

Installation location requirements
- Recessed area, closet, or alcove.
- Solid, level floor. Must support 280-lbs. min.
- Towable trailer/watercraft: position over axles/mid-ship. Block in to prevent extreme movement.

Electrical requirements
WFL2500X: 120V/60Hz/6amp*)
DV1725X: 120V/60Hz/12.5amp*
(*15amp separate circuit recommended)

Minimum Clearances (from case):			
	Closet	Closet (Alt.)	Under-counter
Sides	1/4" (6 mm)	0" (0 mm)	1/4" (6 mm)
Top	1/2" (12 mm)	2-3/4" (68 mm)	1/2" (12 mm)
Rear	1/4" (6 mm)	5/8" (16 mm)	1/4" (6 mm)
Front	1/4" (6 mm)	1/4" (6 mm)	N/A
Vent opening - distance from top of closet			
	6" (150 mm)	2" (50 mm)	N/A

Standpipe drain system requirements:
- Min 1¼" diameter standpipe with 7-GPM carry-away capacity
- Distance from bottom of washer to top of standpipe: 25" min. / 34" max.
- Min. distance from bottom of washer case to outlet end of drain hose: 20"
- Air break required to avoid siphoning
- 7.5-145 PSI water pressure

Dryer exhaust requirements:
- DO NOT exhaust into chimney, furnace, cold air duct, attic, crawl space, or another duct used for venting
- Two, 72 square-inch ventilation openings req. if using a closet door. Louvered doors with equiv. air openings are acceptable. Allow clearance for knobs, buttons, cabinet moldings, etc.
- Rigid or flexible metallic duct required (not included). Ducting must slope downwards and away from the machine.

c UL us LISTED

Never reuse data sheets. Data sheets are subject to change without notice. Never use data sheets for final installation criteria.
For complete installation information, refer to the owners manual that comes with the unit (also available upon request).